
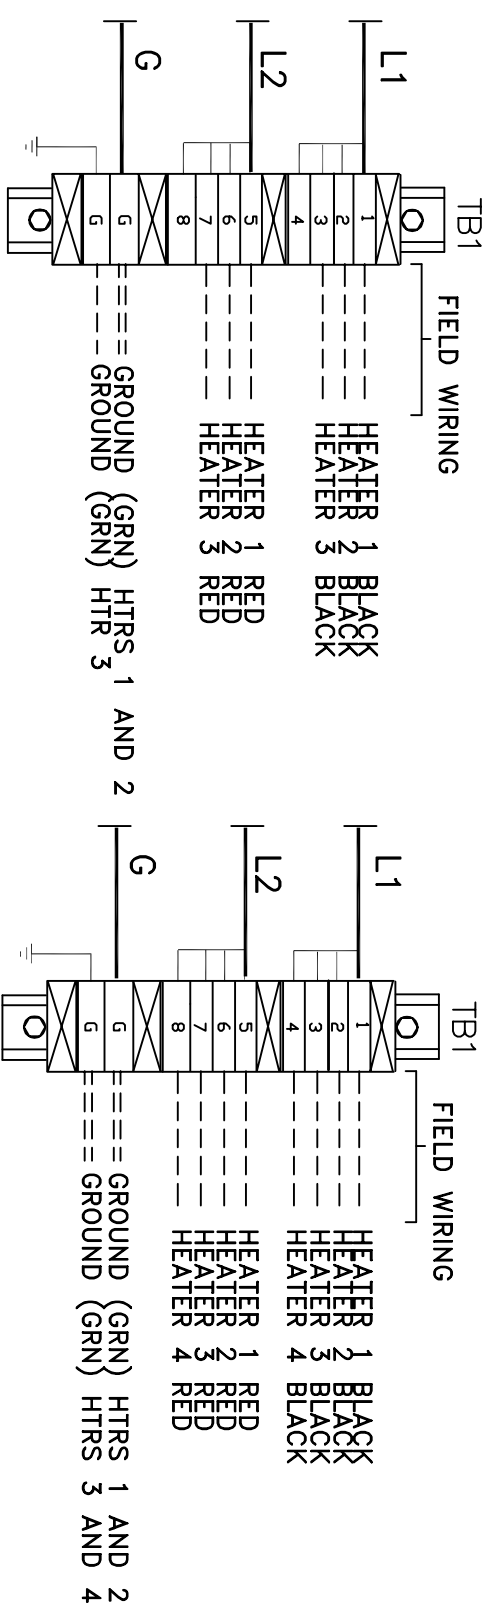


- NOTES:
1. AS SHOWN FOR NON CLASSIFIED AREAS ONLY. 240 V APPLICATIONS.
 2. AS SHOWN FOR USE WITH UP TO FOUR (4) SO CORDSET TYPE FLEXIPANELS. INSTALL HEATERS AS PER INSTRUCTIONS SUPPLIED WITH HEATER.
 3. FIELD INSTALL FITTINGS FOR HEATERS AS REQUIRED. 4 HEATERS MAXIMUM.
 4. THERMOSTATS RATED 30 AMPS PER SWITCH AT 250 VAC.
 5. ENCLOSURE IS NEMA 4X RATED HOFFMAN MODEL A-16148CHSCFG.
 6. LOCATE OVERLIMIT BULB PER DWG 54A109S1 (HORIZONTAL TANK) OR DWG 54A108S1 (VERTICAL TANK)

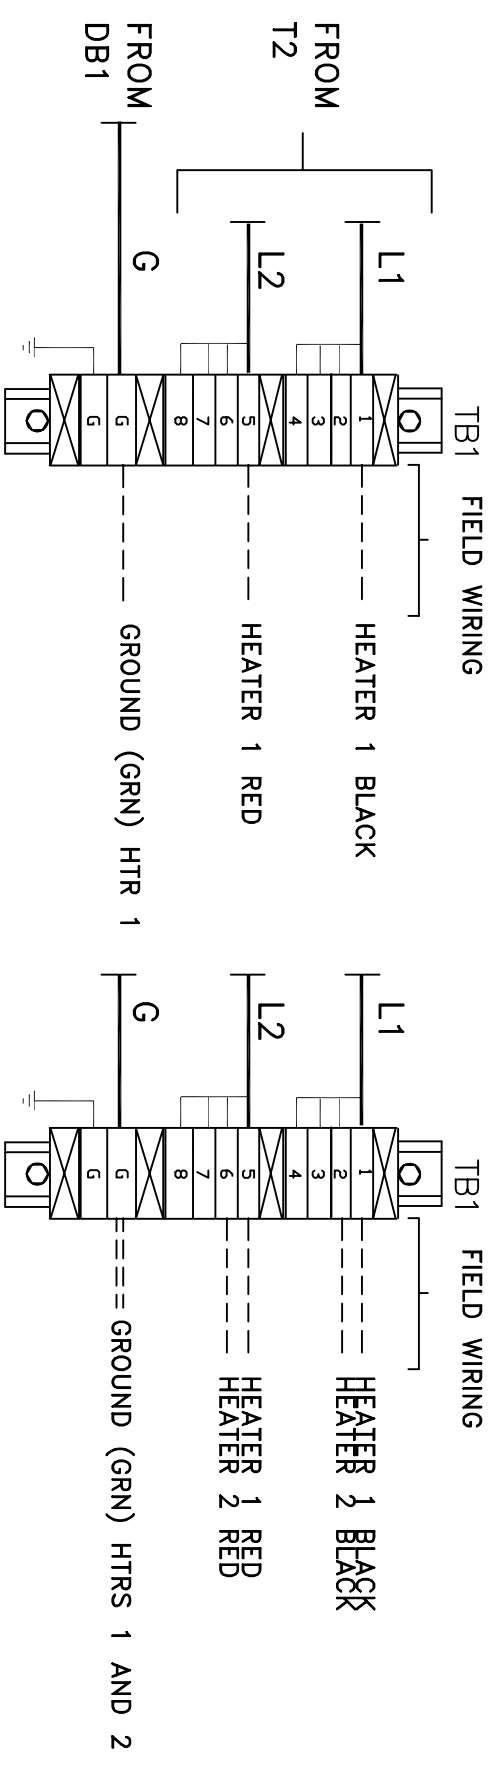

SELECT CONFIGURATION REQUIRED, INSTALL ONE FITTING PER HEATER. FITTING IS T&B 2522 WITH #141 LOCKNUT. INCLUDED IN SHIPMENT.

REV	DATE	DESCRIPTION OF REVISION	DRAWN	DESIGNED	REVIEWED	APPROVED	<p>CONTROL SYSTEM JB-2-2-235-4-SO 240 VOLT ORDINARY AREAS PART# 261111</p>	<p>THERMON MANUFACTURING COMPANY THE HEAT TRACING SPECIALISTS</p>	<p>THERMON PROJECT NUMBER</p>	<p>THERMON DWG. NO. 26111-24</p>	<p>SHT. 1/11</p>	<p>REV. 2</p>
0	10/2/96	INITIAL ISSUE	RJT	RJT	LB	AM						
1	8/28/97	ADDED MULTIPLE HEATER WIRING OPTION	RJT	RJT	LB	AM						
2	8/16/00	ENCLOSURE WAS CARLON CJ16147.	RJT	RJT	HH	AM						
<p>THIS DRAWING IS THE PROPERTY OF THERMON MANUFACTURING COMPANY. IS CONFIDENTIAL AND MUST NOT BE MADE PUBLIC OR COPIED AND IS SUBJECT TO RETURN ON DEMAND. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.</p> <p>ISO 9001 CERTIFIED COMPANY</p>												
<p>DISK# 26111.2</p>												