


- NOTES:
1. AS SHOWN FOR NON CLASSIFIED AREAS ONLY. 240 V APPLICATIONS.
 2. AS SHOWN FOR USE WITH EIGHT (8) RT/RTF STYLE FLEXIPANELS. INSTALL AS PER INSTRUCTIONS SUPPLIED WITH HEATER.
 3. FIELD INSTALL FITTINGS FOR HEATERS AS REQUIRED. 8 TOTAL.
 4. THERMOSTATS RATED 30 AMPS AT 240 VOLTS.
 5. ENCLOSURE IS NEMA 4X RATED HOFFMAN A-16148CHSCFG.
 6. LOCATE OVERLIMIT BULB PER THE FOLLOWING DWGS:
54A109S1 FOR HORIZONTAL TANK ARRANGEMENT.
54A108S1 FOR VERTICAL TANK ARRANGEMENT.

FRONT VIEW

SIDE VIEW

PAN LAYOUT

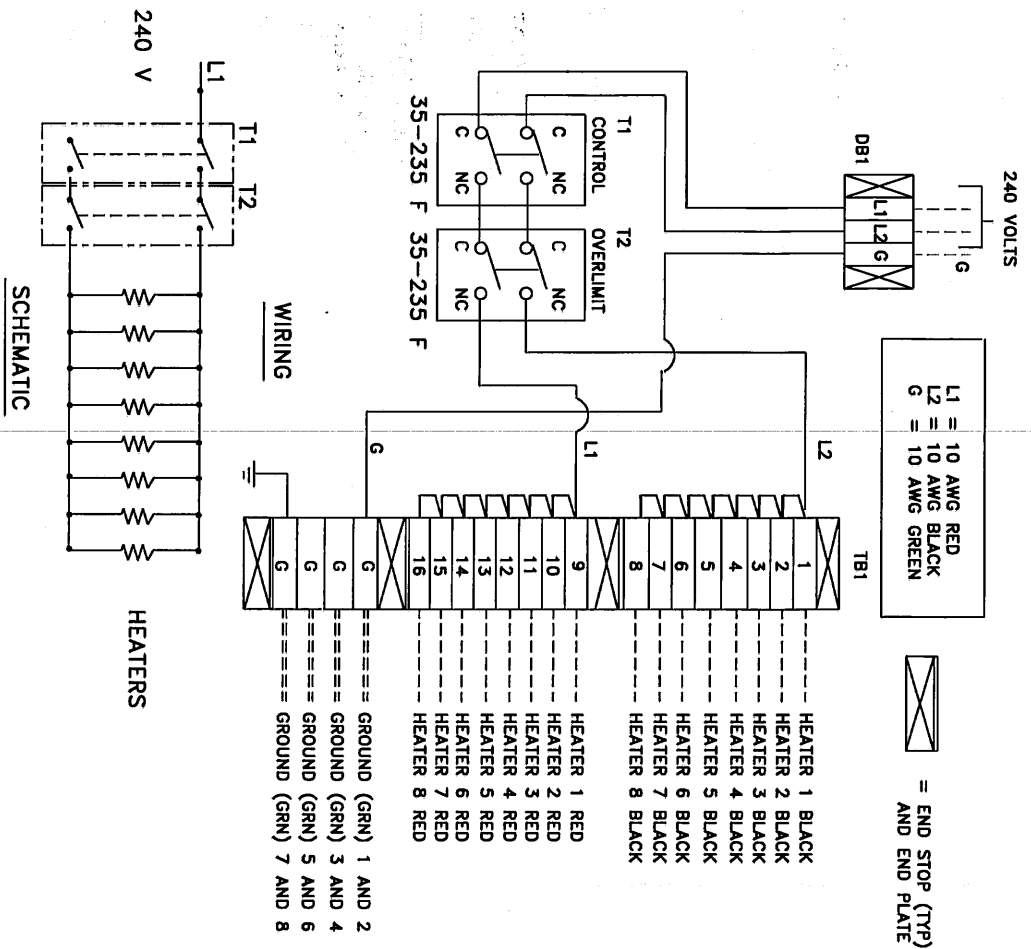

WIRING

SCHEMATIC

REV	DATE	DESCRIPTION OF REVISION	DRAWN	DESIGNED	REVIEWED	APPROVED
1	10/17/03	ENCLOSURE WAS CARLON CJ16147.	RJT	RJT	HH	AM
0	1/22/98	INITIAL ISSUE	RJT	RJT	LB.	AM

CONTROL SYSTEM
JB-2-2-235-8-RT
240 VOLT , 8 HTRS
PART# 26120

THIS DRAWING IS THE PROPERTY OF THERMON MANUFACTURING COMPANY. IT IS CONFIDENTIAL AND NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THERMON MANUFACTURING COMPANY. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.
ISO 9001 CERTIFIED COMPANY

THERMON PROJECT NUMBER
THERMON MANUFACTURING COMPANY
THERMON DWG. NO. H-26120-28
THE HEAT TRACING SPECIALISTS
SHT. . REV. 1

DISK#